


REV.	DESCRIPTION

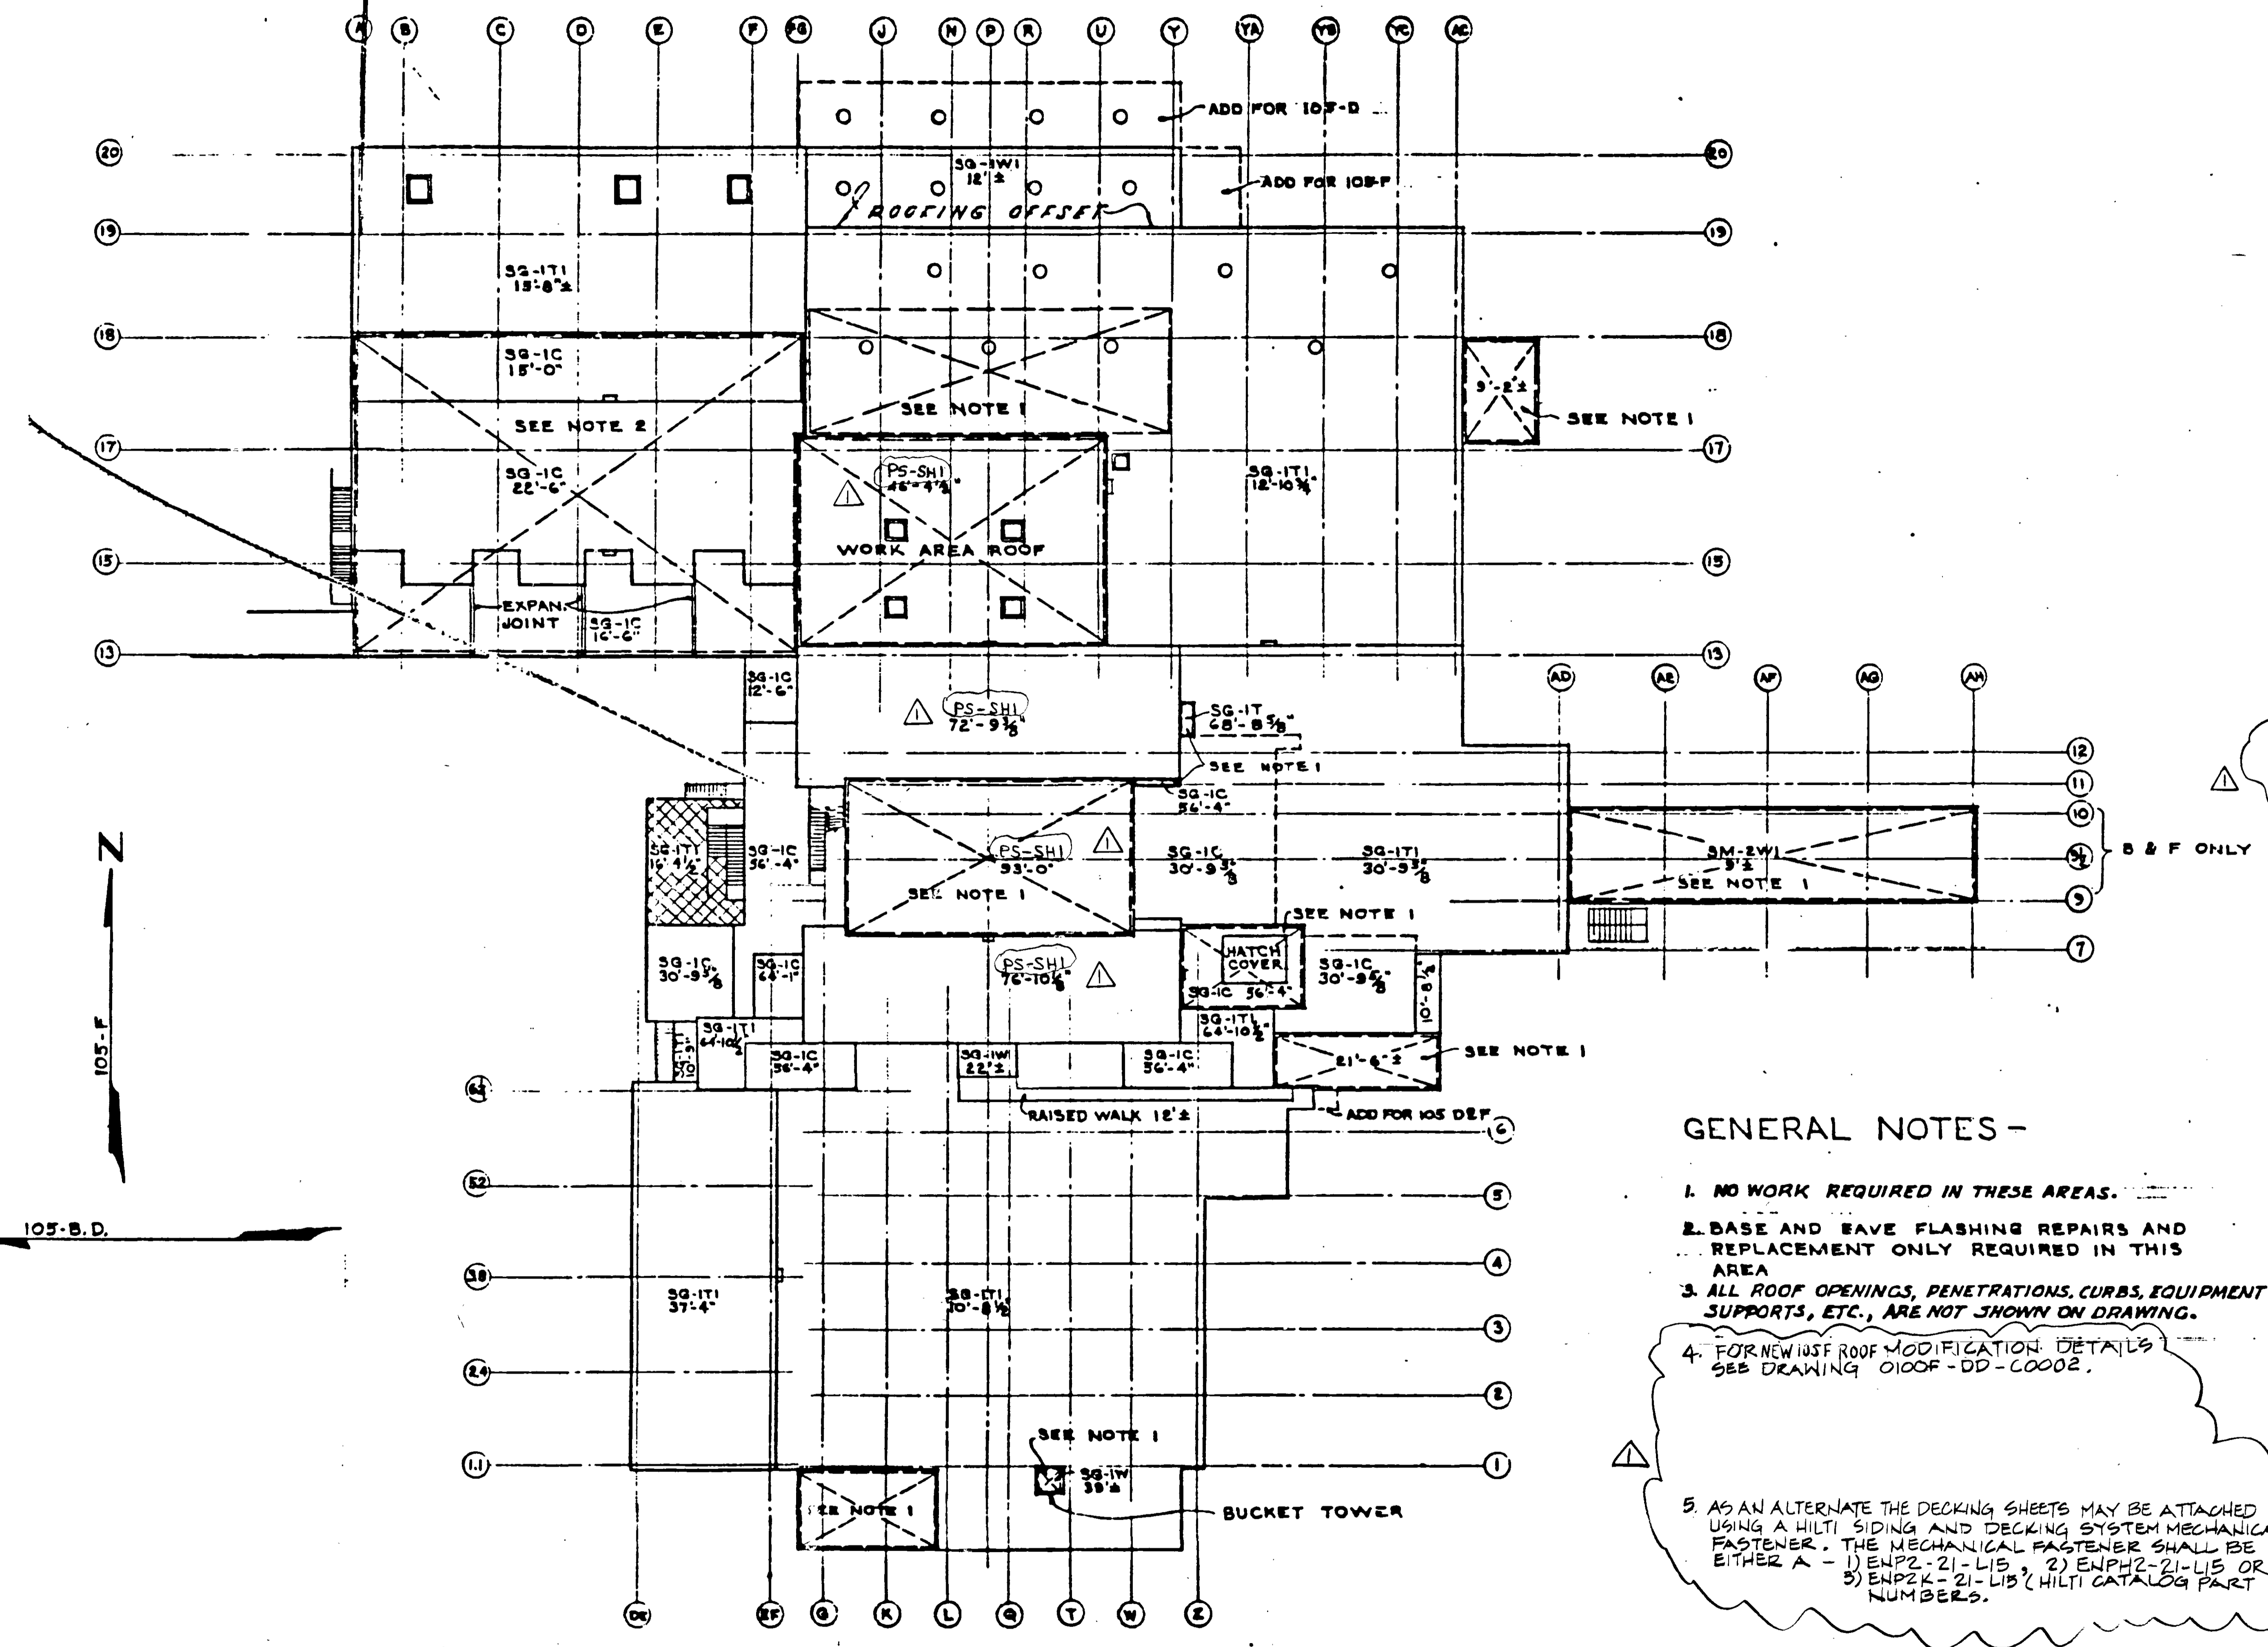

LEGEND

- SG-1C - ROOFING - ROOF DECK
30'-9 1/2" ELEV. ROOF DECK ABOVE GROUND FL. @ 0'-0"
- SG - SLAG OR GRAVEL SURFACE
- SM - SMOOTH SURFACE
- 1C - CONCRETE DECK - SLOPE LESS THAN 1/8" PER FOOT
- 1T - PRECAST CONCRETE TILE SLAB SLOPE LESS THAN 1/8" PER FOOT
- 1TI - SAME AS '1T' WITH INSULATION
- 1W - WOOD DECK - SLOPE LESS THAN 1/8" PER FOOT
- 1WI - SAME AS '1W' WITH INSULATION
- 2WI - WOOD DECK WITH INSULATION SLOPE 1/2" TO 2" PER FOOT
- NEW ASPHALT PLANKING (WORK AREA) OVER NEW ROOFING.
- PS - POLYURETHANE FOAM SURFACE WITH SILICONE SEALANT.
- SHI - SHEET METAL ROOF, REPLACED ORIGINAL PRE-CAST CONCRETE ROOF. INSULATED WITH 5/8" TYPE "X" CORE GYPSUM PANEL.

GENERAL NOTES -

1. NO WORK REQUIRED IN THESE AREAS.
2. BASE AND EAVE FLASHING REPAIRS AND REPLACEMENT ONLY REQUIRED IN THIS AREA
3. ALL ROOF OPENINGS, PENETRATIONS, CURBS, EQUIPMENT SUPPORTS, ETC., ARE NOT SHOWN ON DRAWING.
4. FOR NEW USE ROOF MODIFICATION DETAILS SEE DRAWING 0100F-DD-C0002.
5. AS AN ALTERNATE THE DECKING SHEETS MAY BE ATTACHED USING A HILTI SIDING AND DECKING SYSTEM MECHANICAL FASTENER. THE MECHANICAL FASTENER SHALL BE EITHER A - 1) ENP2-21-L15, 2) ENP2-21-L15 OR 3) ENP2K-21-L15 (HILTI CATALOG PART NUMBERS).

APPROVED

VOID

DESCRIPTION	REV. BY	DATE	APP'D BY	DATE
REVISIONS				
H-1-10458				
CLASSIFICATION				
NONE				
SCALE: 1/4" = 1'-0"				
DATE: 8/13/57				
NO. 12908				
CA-762				
U. S. ATOMIC ENERGY COMMISSION HANFORD ATOMIC PRODUCTS OPERATION GENERAL ELECTRIC				
COMPOSITE ROOF PLAN				
GRAVEL SURFACE ROOF REPAIRS 100-BCD,DR,FH				
H-1-10458				
0800				

REV.	DATE	DESCRIPTION	DRAWN BY	CHECKED BY	DATE
1	1/31/52	THIS DRAWING IS VOID	DKM	EGE	
2	7/24/57	ISSUED FOR ECP-10-0033 DCN-H-1-10458 TO 100-BCD,DR,FH			

BHI-DIS 2/28/57 KW