
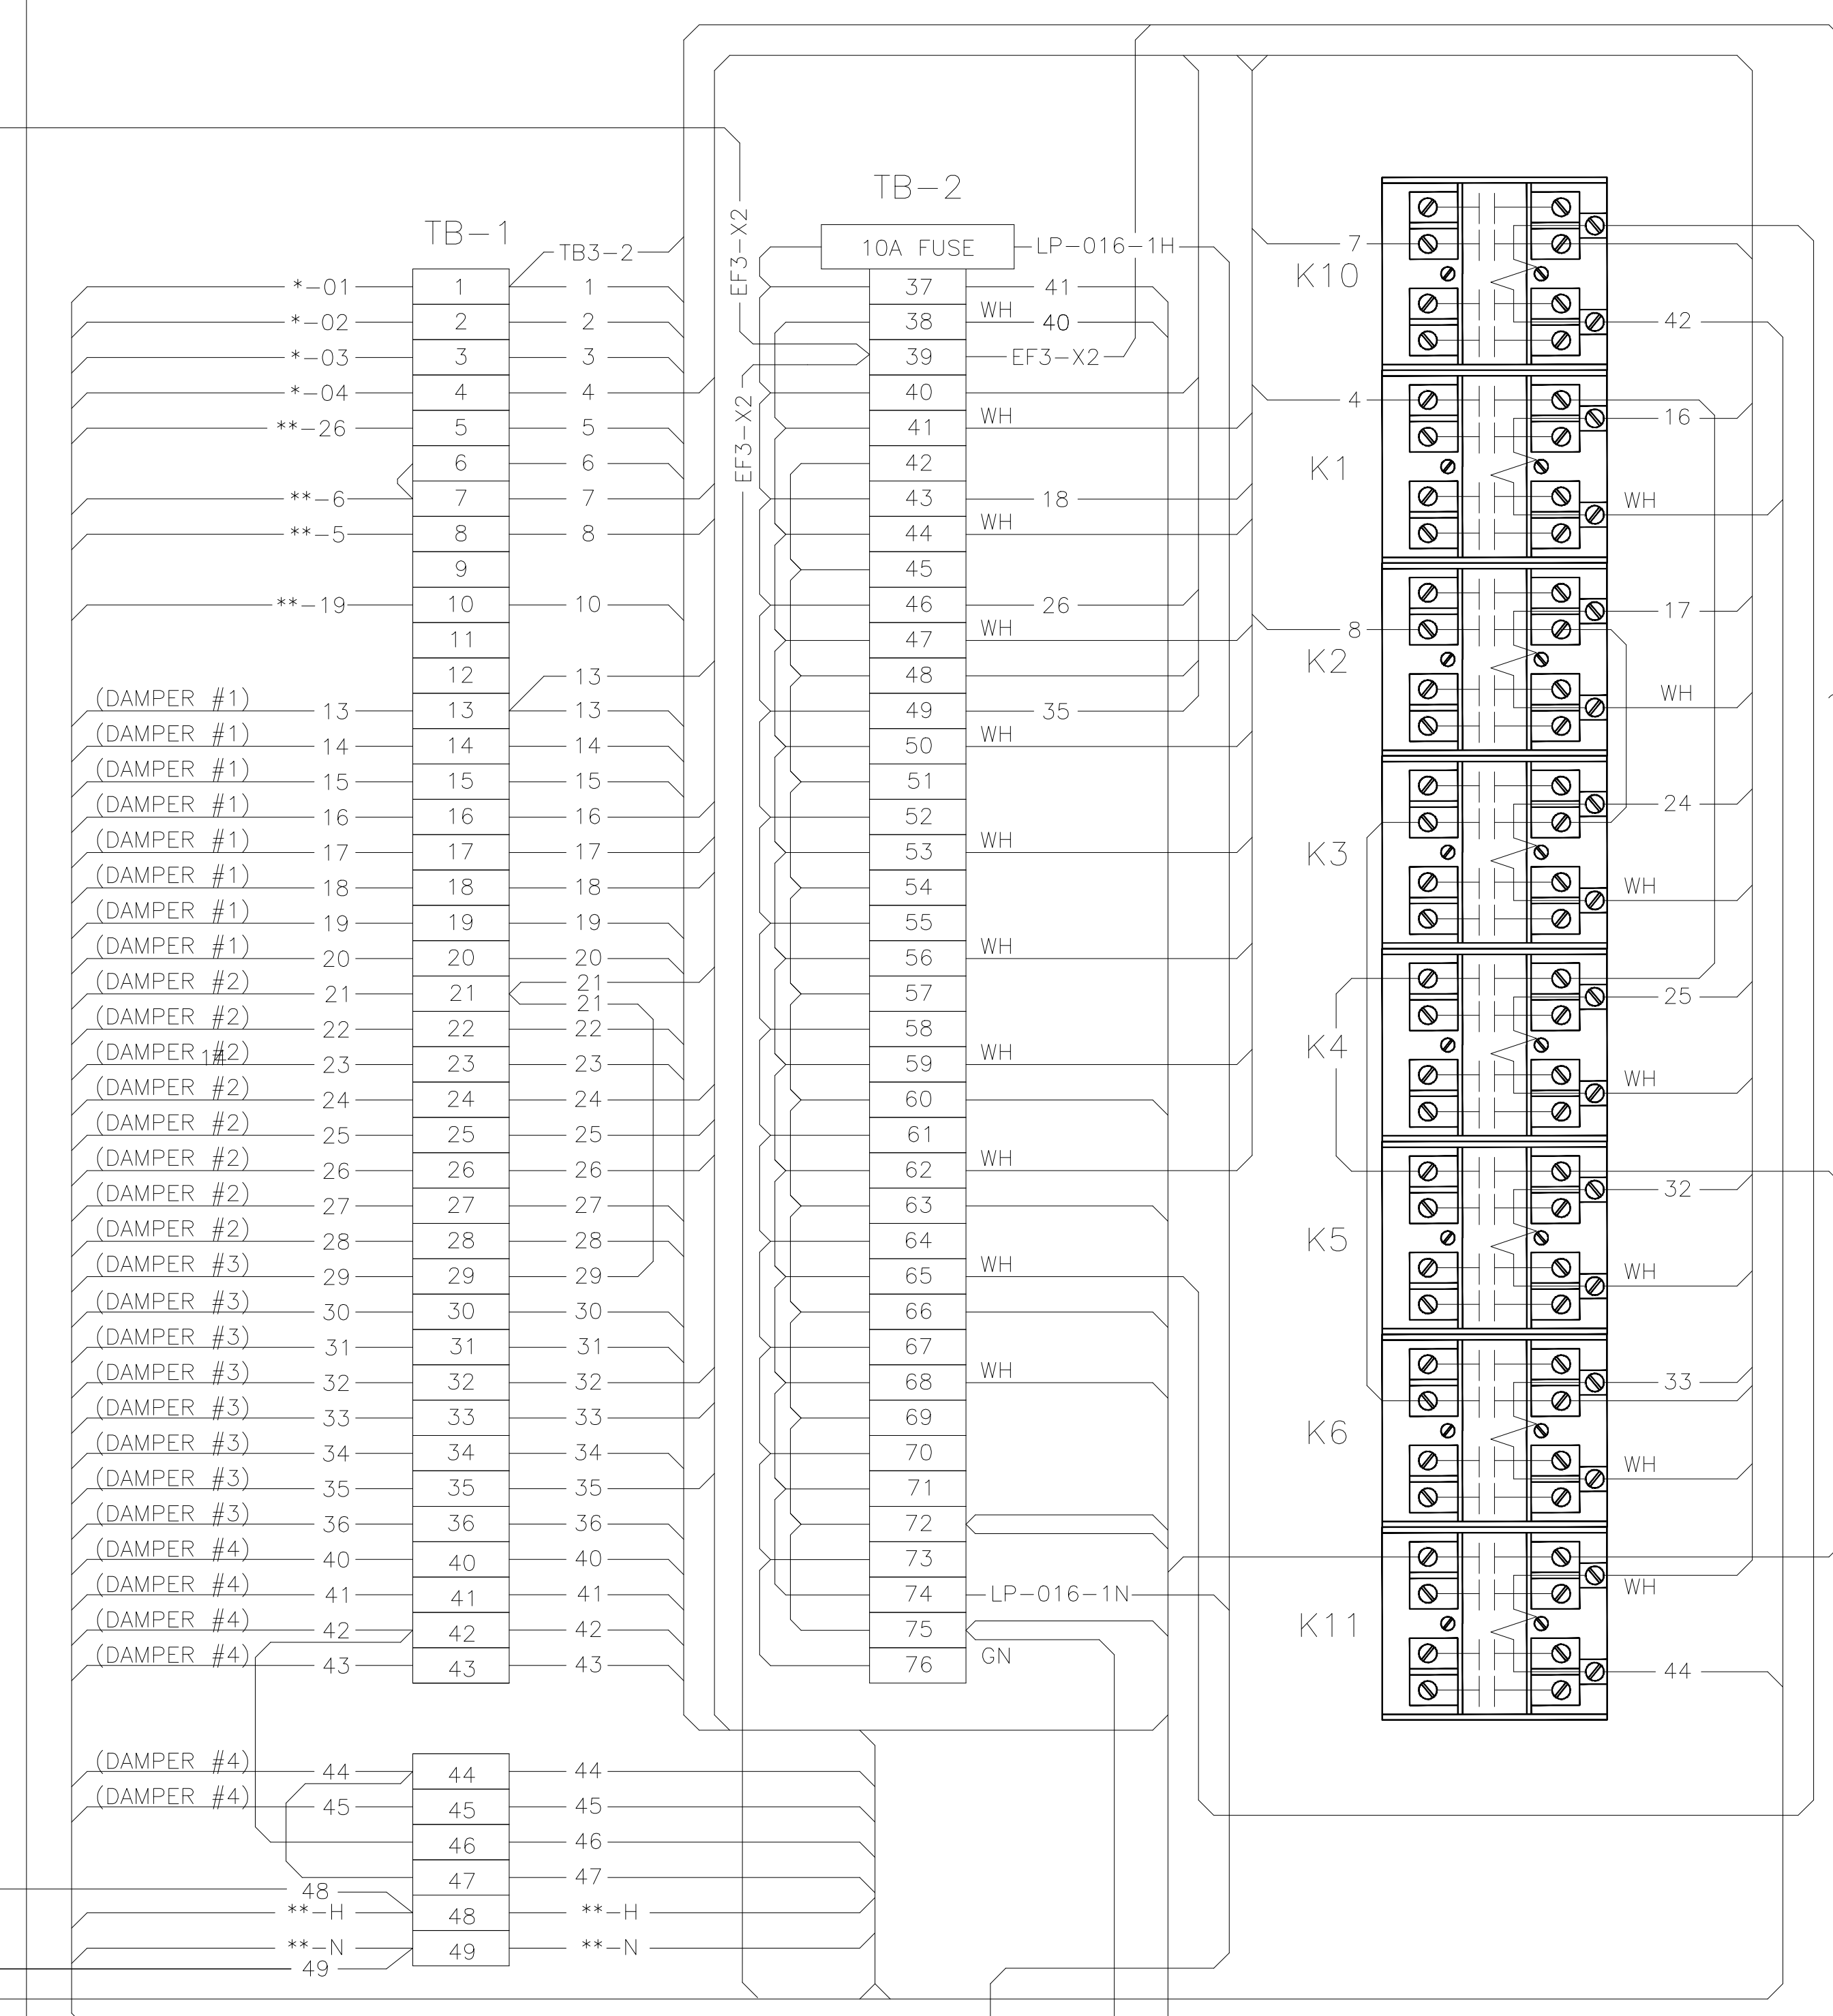


(REAR DOOR VIEW)

(INTERIOR MOUNTING PANEL)

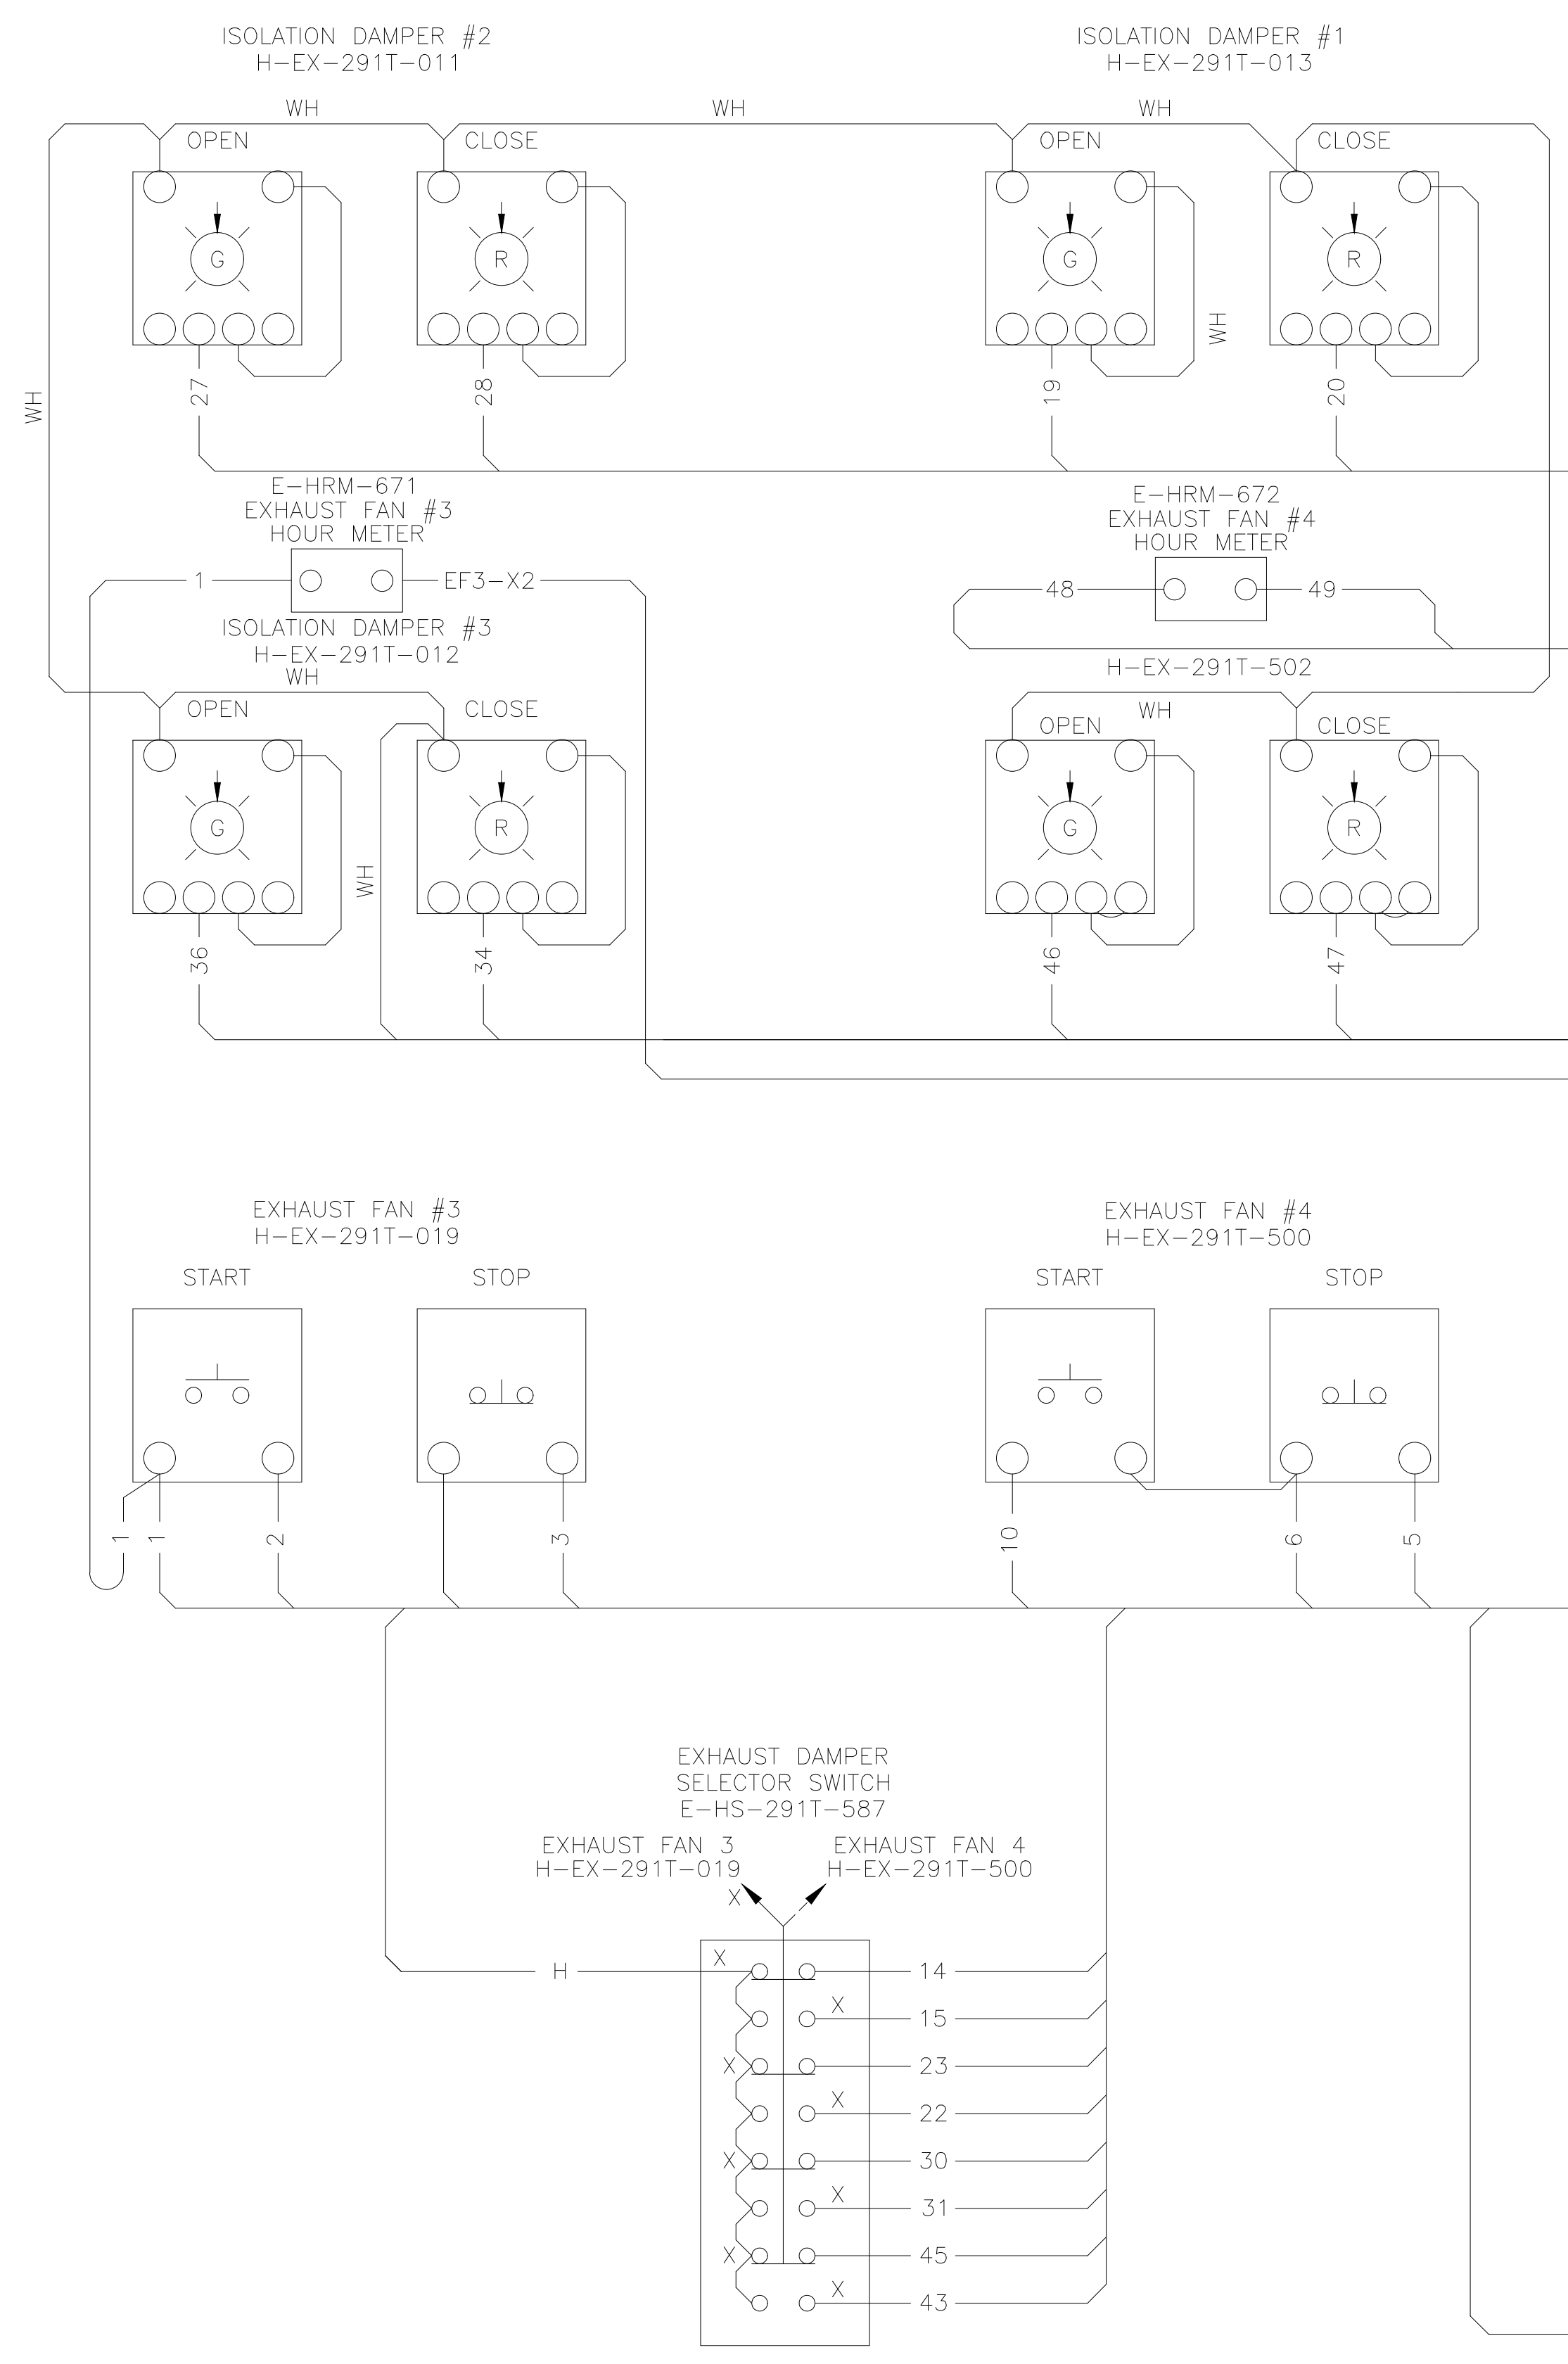

TO RELAY PANEL
E-XX-291T-335
SEE H-2-830964

TO STACK MONITOR FLOW
SWITCH INTERLOCK RELAY
AY-FS (H-2-830964 SH 1)
(LP-536-1H: AY-FS COMMON,
LP-536-1H1: AY-FS COIL)

EXHAUST FAN CONTROL PANEL E-XX-291T-020
INTERCONNECTION DIAGRAM
*- E-EX-291T-010
**- E-EX-291T-470

- TO ISOLATION DAMPER #2 H-EX-291T-011
- TO ISOLATION DAMPER #1 H-EX-291T-013
- TO ISOLATION DAMPER #4 H-EX-291T-502
- TO MINI POWER CENTER H-EX-291T-016
- TO FAN #3 CONTROLLER H-EX-291T-010
- TO ISOLATION DAMPER #3 H-EX-291T-012
- TO VARIABLE FREQUENCY DRIVE H-EX-291T-470

DATE: Aug 29, 2019
HANFORD RELEASE

BLDG. NO. 291T	CAUTION NOT COMPLETE WITHOUT CURRENT CHANGE DOCUMENTS FROM DATABASE	ATTENTION DESTROY THIS DOCUMENT BY SHREDDING MAY CONTAIN SENSITIVE INFORMATION
NAME H4519458-JS POGUE	DATE 8/29/2019	COMPANY PRC
DESIGN AUTHORITY H9211889-KJ DOELL		
U.S. DEPARTMENT OF ENERGY Richland Operations Office		
ELECTRICAL EXHAUST FAN CONTROL PANEL INTERCONNECTION DIAGRAM		
INDEX NO. 7302 7502	SIZE F	DRAWING NUMBER H-2-832080
		SHEET 1
		REV 1
		SCALE NONE

DWG NUMBER	TITLE	REF NUMBER	TITLE	REV	DESCRIPTION
				1	REVISED PER HNF-FMP-06-29548-R0
DRAWING TRACEABILITY LIST			REFERENCES		
NEXT USED ON			REVISIONS		